SEQUENCE OF OPERATION

1. General lighting (a) Partial On to 50% and controlled receptacles Auto On when occupancy detected.
2. Manual On/Off/Dim general lighting (a) and down lighting (b, c) with scene switches.
3. Scene settings

General Lighting	(a) 100%, (b) 0%, (c) 0%,
Video	(a) 0%, (b) 75%, (c) 50%,
Conferencing	(a) 50%, (b) 50%, (c) 25%,
All Off	(a) 0%, (b) 0%, (c) 0%,

4. Auto off all lighting and controlled receptacles within 20 minutes of occupants leaving.

Note: Diagram is typical for space type. Provide proper quantity and type of occupancy sensors, switches, room controllers, daylighting sensors, etc., per code requirement for each space.



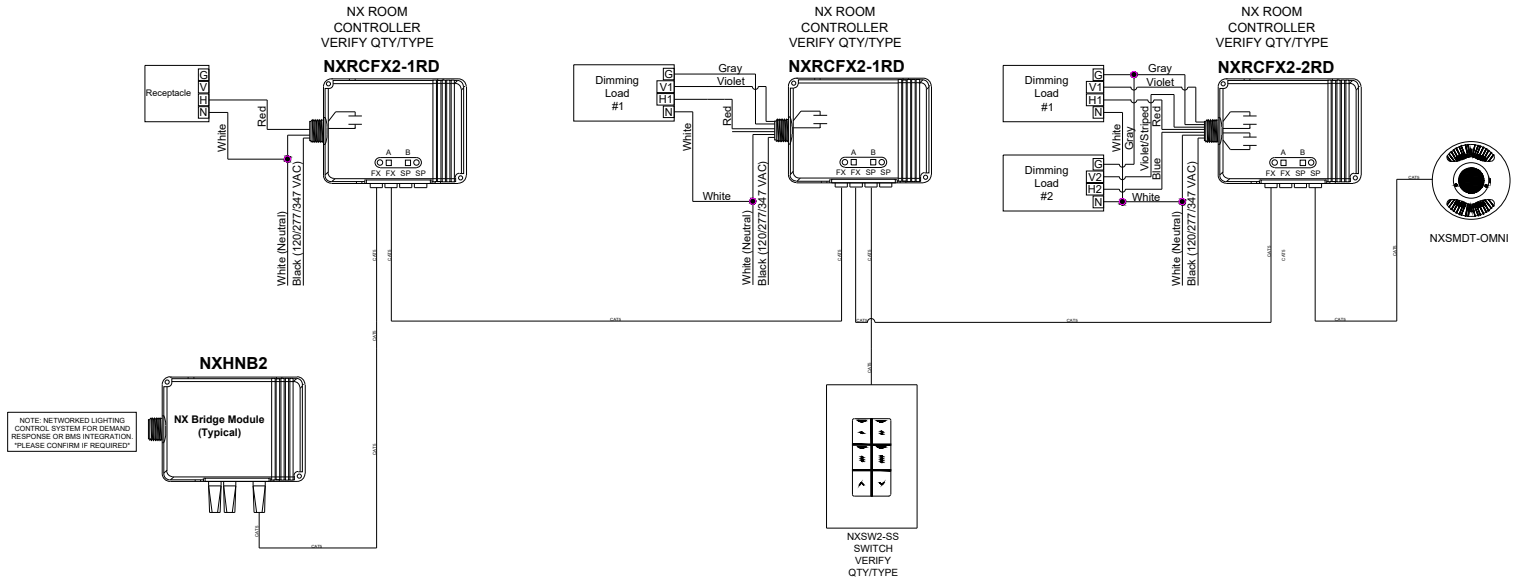

LIGHTING SYSTEMS
www.ltgsys.com
(510) 982-3900
2322 6th Street
Berkeley, CA 94710

TYP SMALL CONFERENCE ROOM - TITLE 24 2022

MANUFACTURER: NX BY CURRENT

WIRING

DATE: 07/26/23

1.2.1